

Certificate of Registration for Membership of Common Biomedical Disposal Facility as per Authorization for Generation, Collection, Reception, Segregation, Storage, and Disposal of Bio-Medical Wastes under Rule 1998 & amended there on.

Registration No. : AMD / 742
Date of Registration : 26th May. 2020.
Date of Issue of Certificate : 23rd March. 2022.
Place : Ahmednagar.
Name & Address : Dr. Vikhe Patil Memorial Hospital
& Medical College.
Opp. Govt Milk Dairy, Vadgaon Gupta,
MIDC, Ahmednagar.
Type of Institute : Hospital.
No. of Beds : 960 (Nine Hundred Sixty)
Approx. Qty. of Waste Generated/day : 130 To 160 Kg.

This Certificate is valid from 23rd March 2022 to 22nd March 2023.

This is to certify that above Doctor / Institute is registered with us and having membership of our CBMWTSDF for collection, transportation & disposal of biomedical waste generated at his / there institute.

Note :- In case of violation of BMW rules 1998 & amended there on or default for due payments of BMW Services all rights are reserved with singing authorities for cancellation of this certificate.



For, Bioclean Systems (India) Pvt. Ltd.

Ahmednagar.



Ahmednagar Office :

Nilayam Housing Society,
Near John Deere Tractors Showroom,
Nagar-Pune Road,
Ahmednagar - 414 001.
Ph. : (0241) 2324131, Mob. 9225322576

Solapur Office :

Plot No.OD, Uma Sahakari
Gruhnirman Sanstha Maryadit,
Solapur, T.P. Scheme No. 4,
Final Plot No. 125/2, Juni Mill Compound,
Murarji Peth, Solapur-1.
Phone : (0217) 6451070, 2324289

Pune Office :

Building No. A-10,
Flat No. 6, Meeranagar,
Koregaon Park,
Pune - 411001 (M.H.),

Dr. Vithalrao Vikhe patil Foundation
Ahmednagar



Dr. Vithalrao Vikhe Patil
Foundation
Ahmednagar


**DESTROMAT INCINERATOR FOR
BIO-MEDICAL WASTE APPLICATION**

PY-VS SERIES MODELS

PY-75VS TO PY-400 VS

PROCESS WATER
@ 3 Kg/CM²(g)

FUEL OIL
LDO/HSD

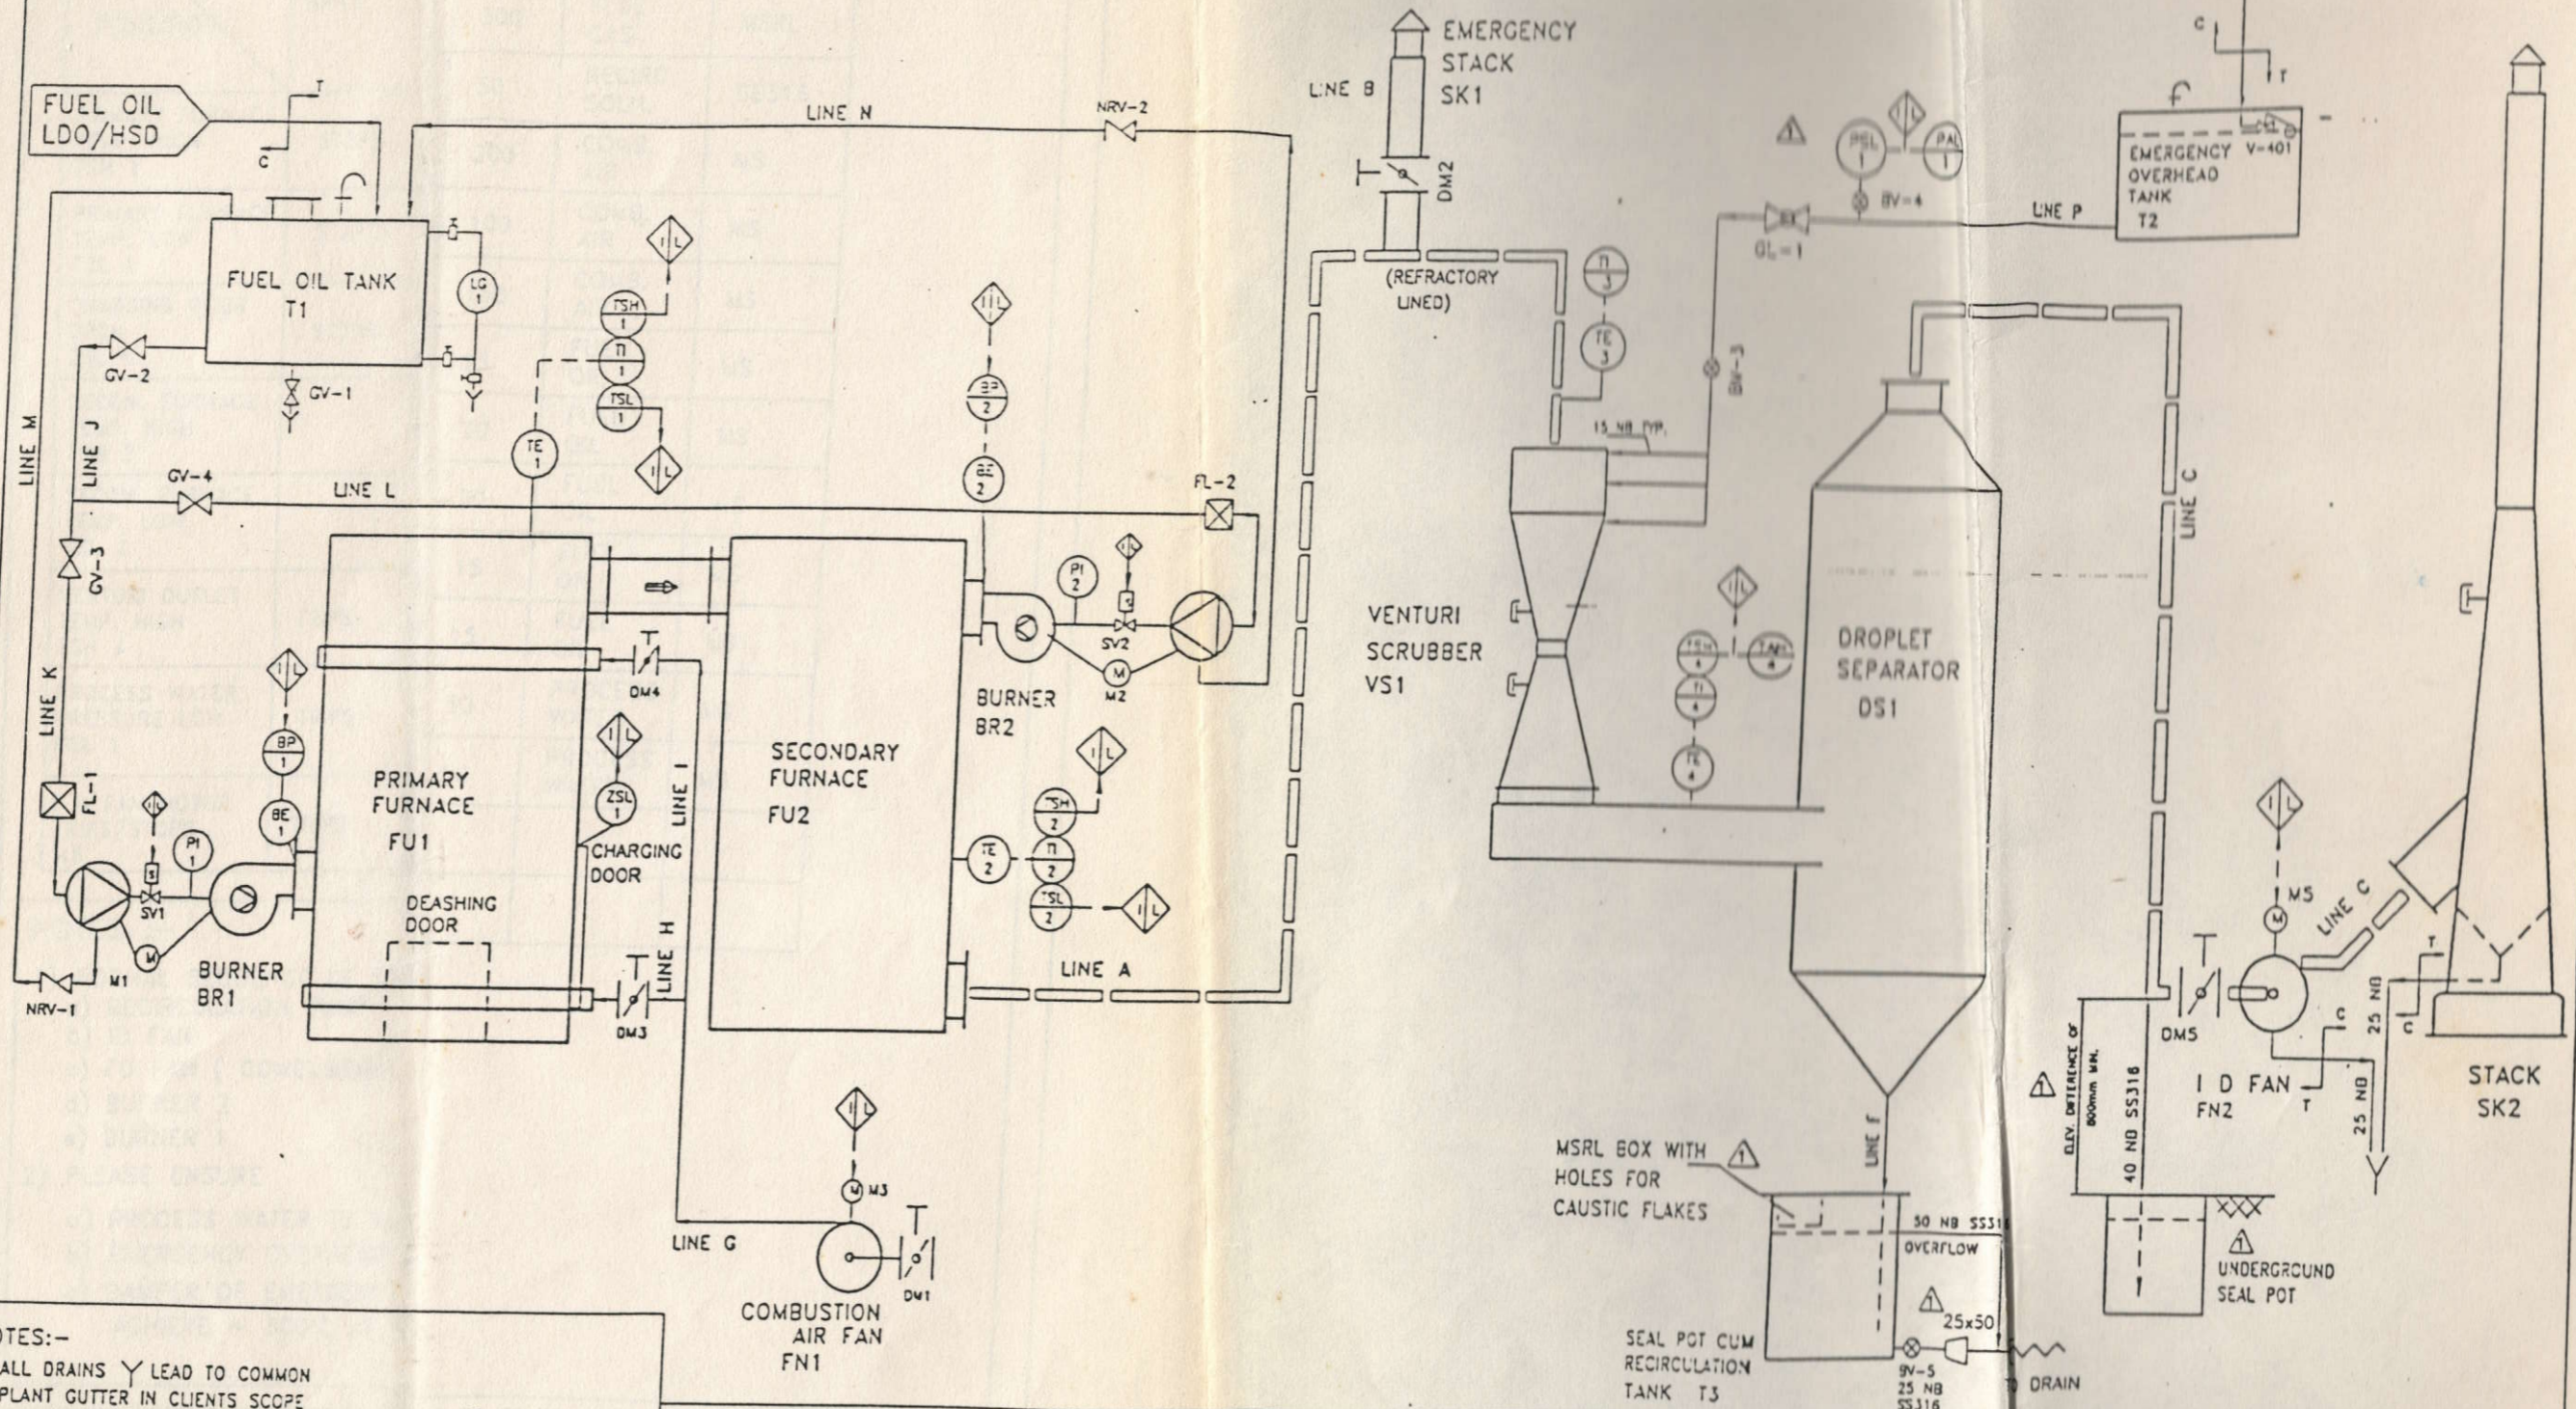

- NOTES:-
- 1) ALL DRAINS Y LEAD TO COMMON PLANT GUTTER IN CLIENTS SCOPE
 - 2) T - THERMAX SCOPE OF SUPPLY
C - CLIENTS SCOPE OF SUPPLY
 - 3) FINAL SCOPE OF SUPPLY WILL BE AS PER OFFER
 - 4) IF PROCESS WATER IS COMING FROM CLIENT'S OVER-HEAD TANK THE EMERGENCY OVERHEAD TANK AND THE PRESSURE SWITCH CAN BE DELETED
 - 5) EMERGENCY OVERHEAD TANK HAS BEEN CONSIDERED TO BE 3m ABOVE THE WATER INJECTION POINT IN VENTURI

PLEASE REFER SHEET 2 FOR
LINE AND INTERLOCK DETAILS

STANDARD SYSTEM FOR DESTROMAT PY 75 TO 400
OPTION II ONCE THROUGH SCRUBBER SYSTEM

TITLE
P & I DIAGRAM FOR
WASTE INCINERATION SYSTEM

THERMAX LIMITED
WASTE MANAGEMENT DIVISION
PUNE

REF. DRG. NO.	
SCALE	DRAWN D.V. SHITOLE 15/1/99
	CHECKED N.M.S. 14-3-99
	APPROVED N.M.S. 14-2-99
DRG. NO.	ALT. NO.
70237 007 30	1
SHEET NO. 1 OF 2	

REV. NO.	REVISION	DATE	MADE BY	CHK. BY	APPR. BY
1	AS PER COMMISSIONING FEEDBACK	25/1/2000			

C:\SHITOLE\STDINC\OPTIOH2\PID.dwg